

# Overview

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629












Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference:  
 Rockfield

Scale: 1:3844 (When plotted at A3)

### IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

### In case of an emergency call 0800 111 999

<b>Dig Sites</b>	<b>Area:</b>  <b>Line:</b> 	 Line/Fire Valve
	Low Pressure (LP) 21mbar – 75mbar	 Governor Station
	Medium Pressure (MP) 350mbar – 2bar	 Change of Diameter
	Intermediate Pressure (IP) 2bar – 7bar	 End Cap
	High Pressure (HP) >7bar	 Depth of cover




**Smell gas?**  
 Call the Gas Emergency Service on 0800 111 999.

**Dial before you dig**  
 We need 10 days' notice

**Dial**  
 Call 029 2027 8912 before you start work.

**Investigate**  
 Before you dig, make sure you know what's below.

**Go ahead**  
 Done your research? Now you can dig safely.

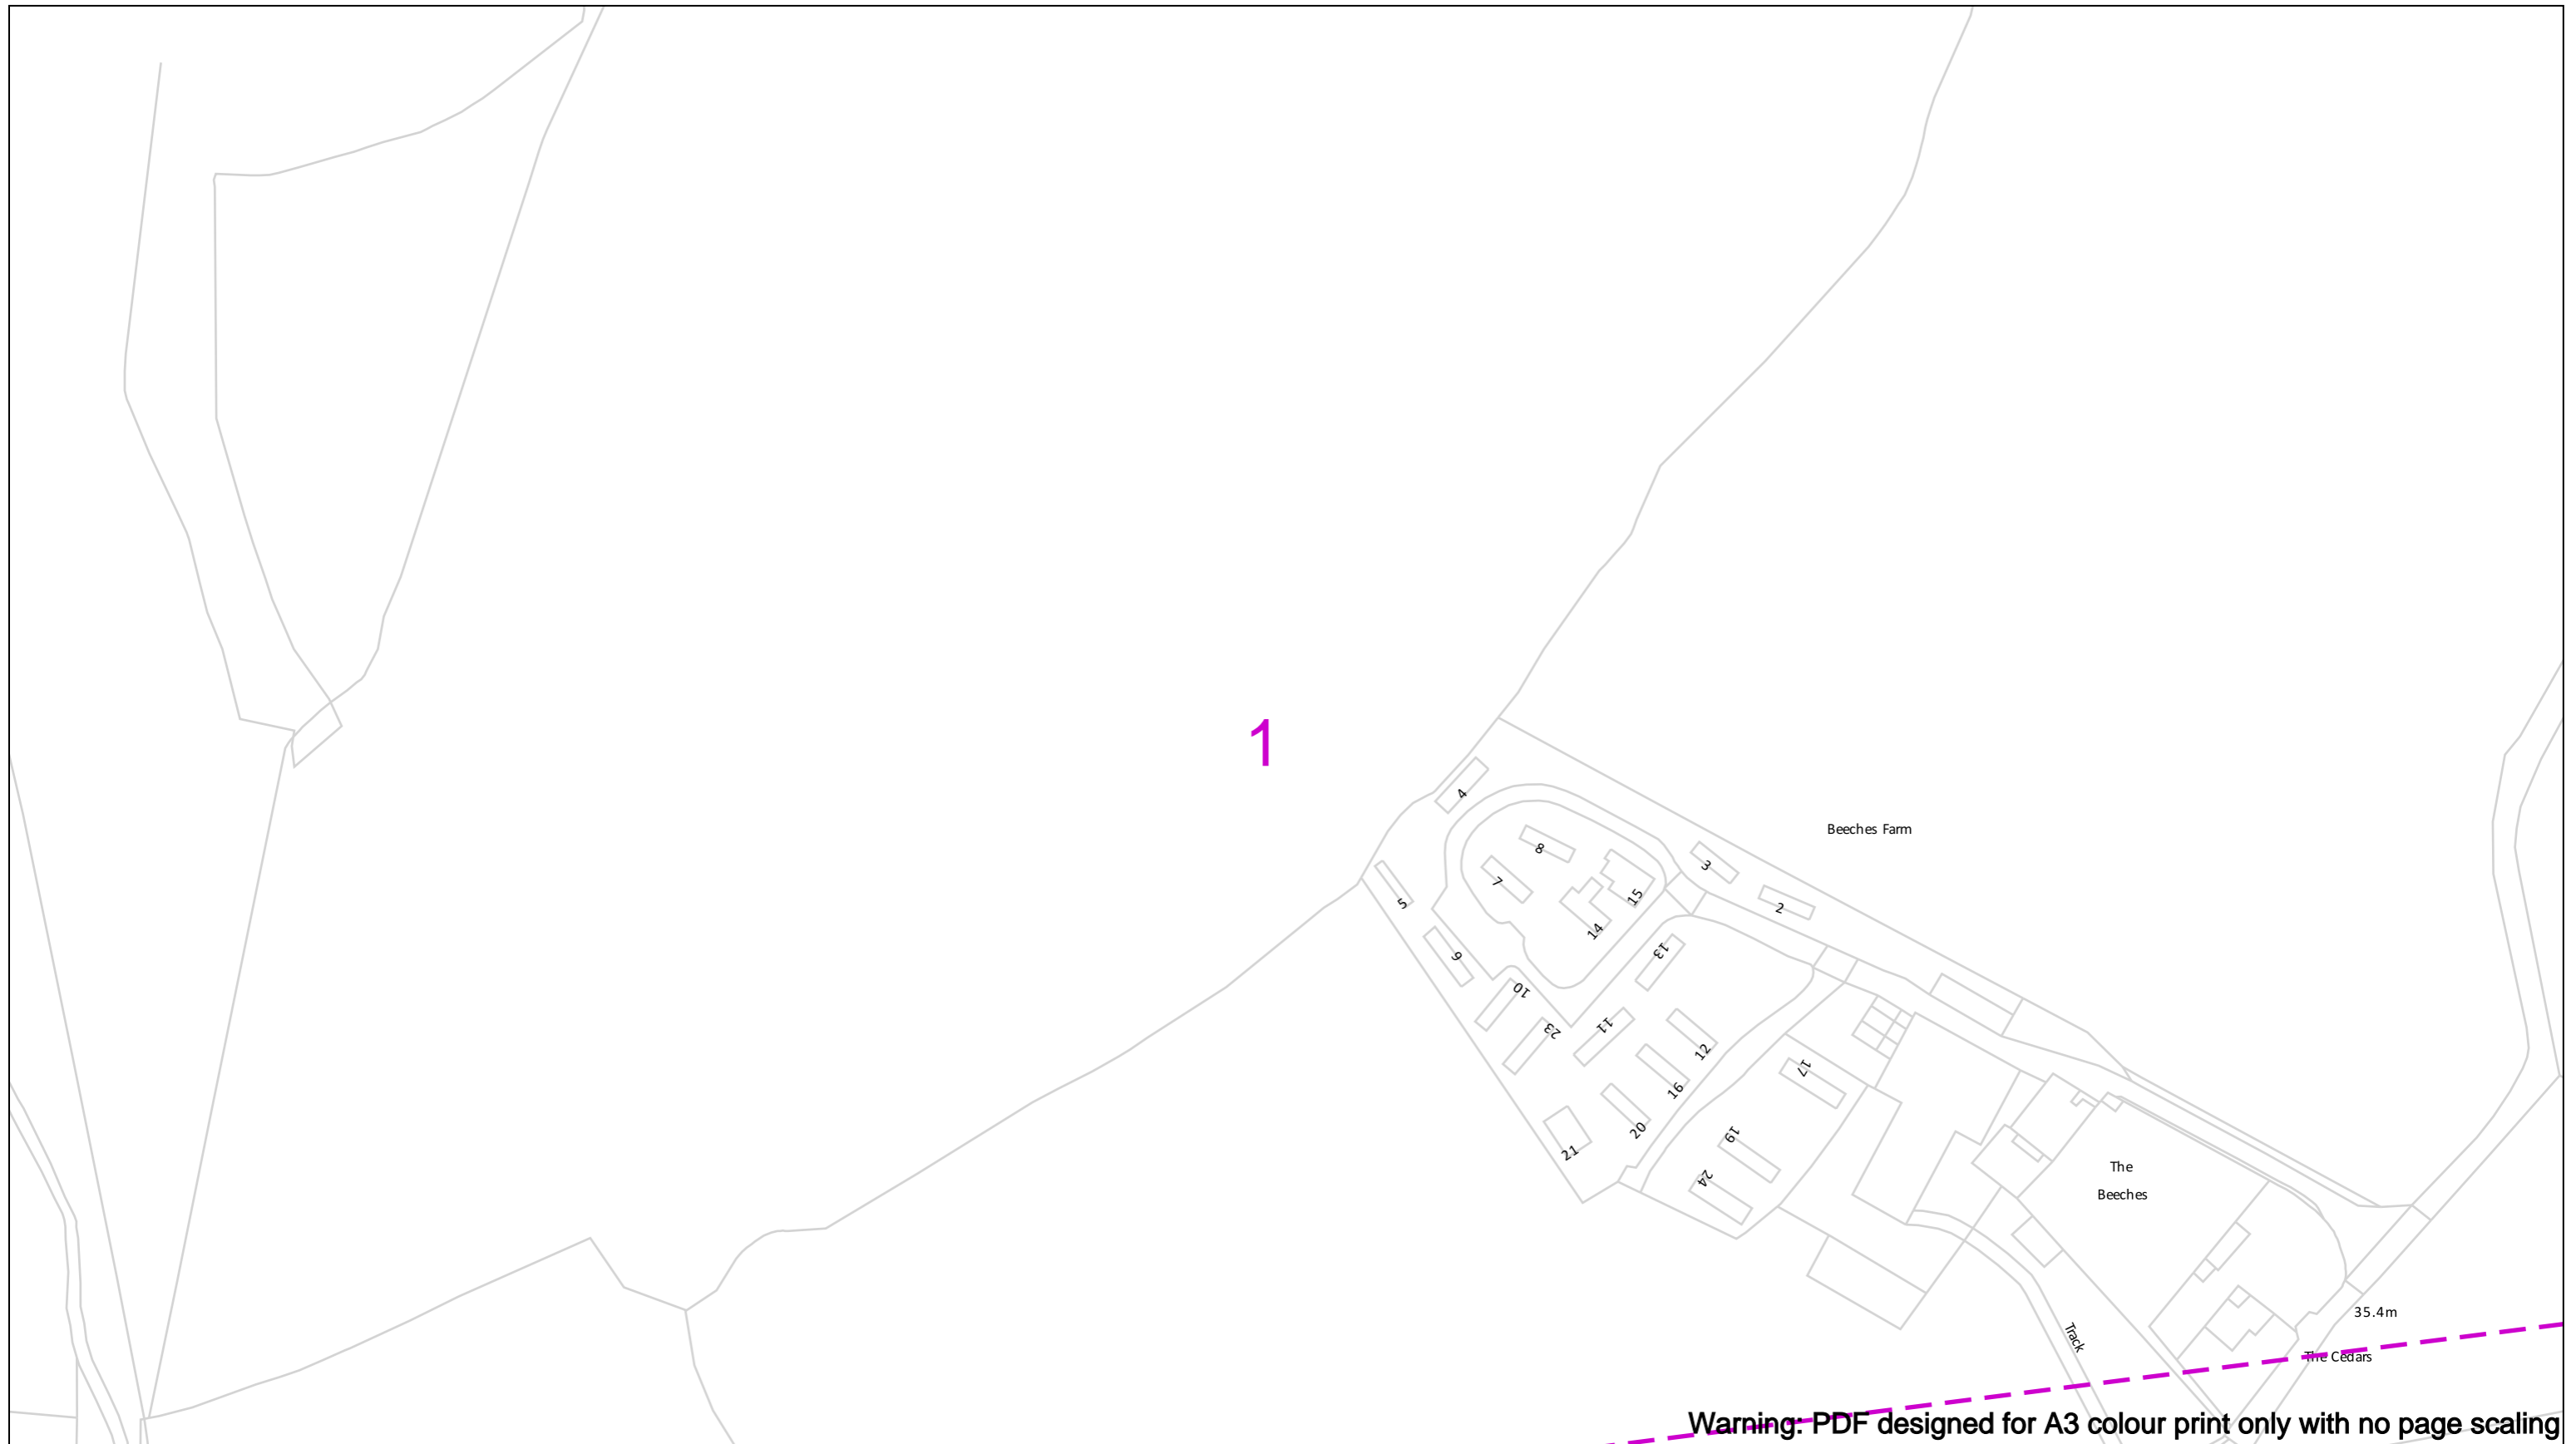

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629

Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

100m

<b>Dig Sites</b>	Area:	Line:		Line/Fire Valve
	Low Pressure (LP) 21mbar – 75mbar			Governor Station
	Medium Pressure (MP) 350mbar – 2bar			Change of Diameter
	Intermediate Pressure (IP) 2bar – 7bar			End Cap
	High Pressure (HP) >7bar			Depth of cover

**WALES & WEST UTILITIES**

**Dial before you dig**


We need 10 days' notice

Smell gas? Call the Gas Emergency Service on 0800 111 999.

Dial Call 029 2027 8912 before you start work.

Investigate Before you dig, make sure you know what's below.

Go ahead Done your research? Now you can dig safely.

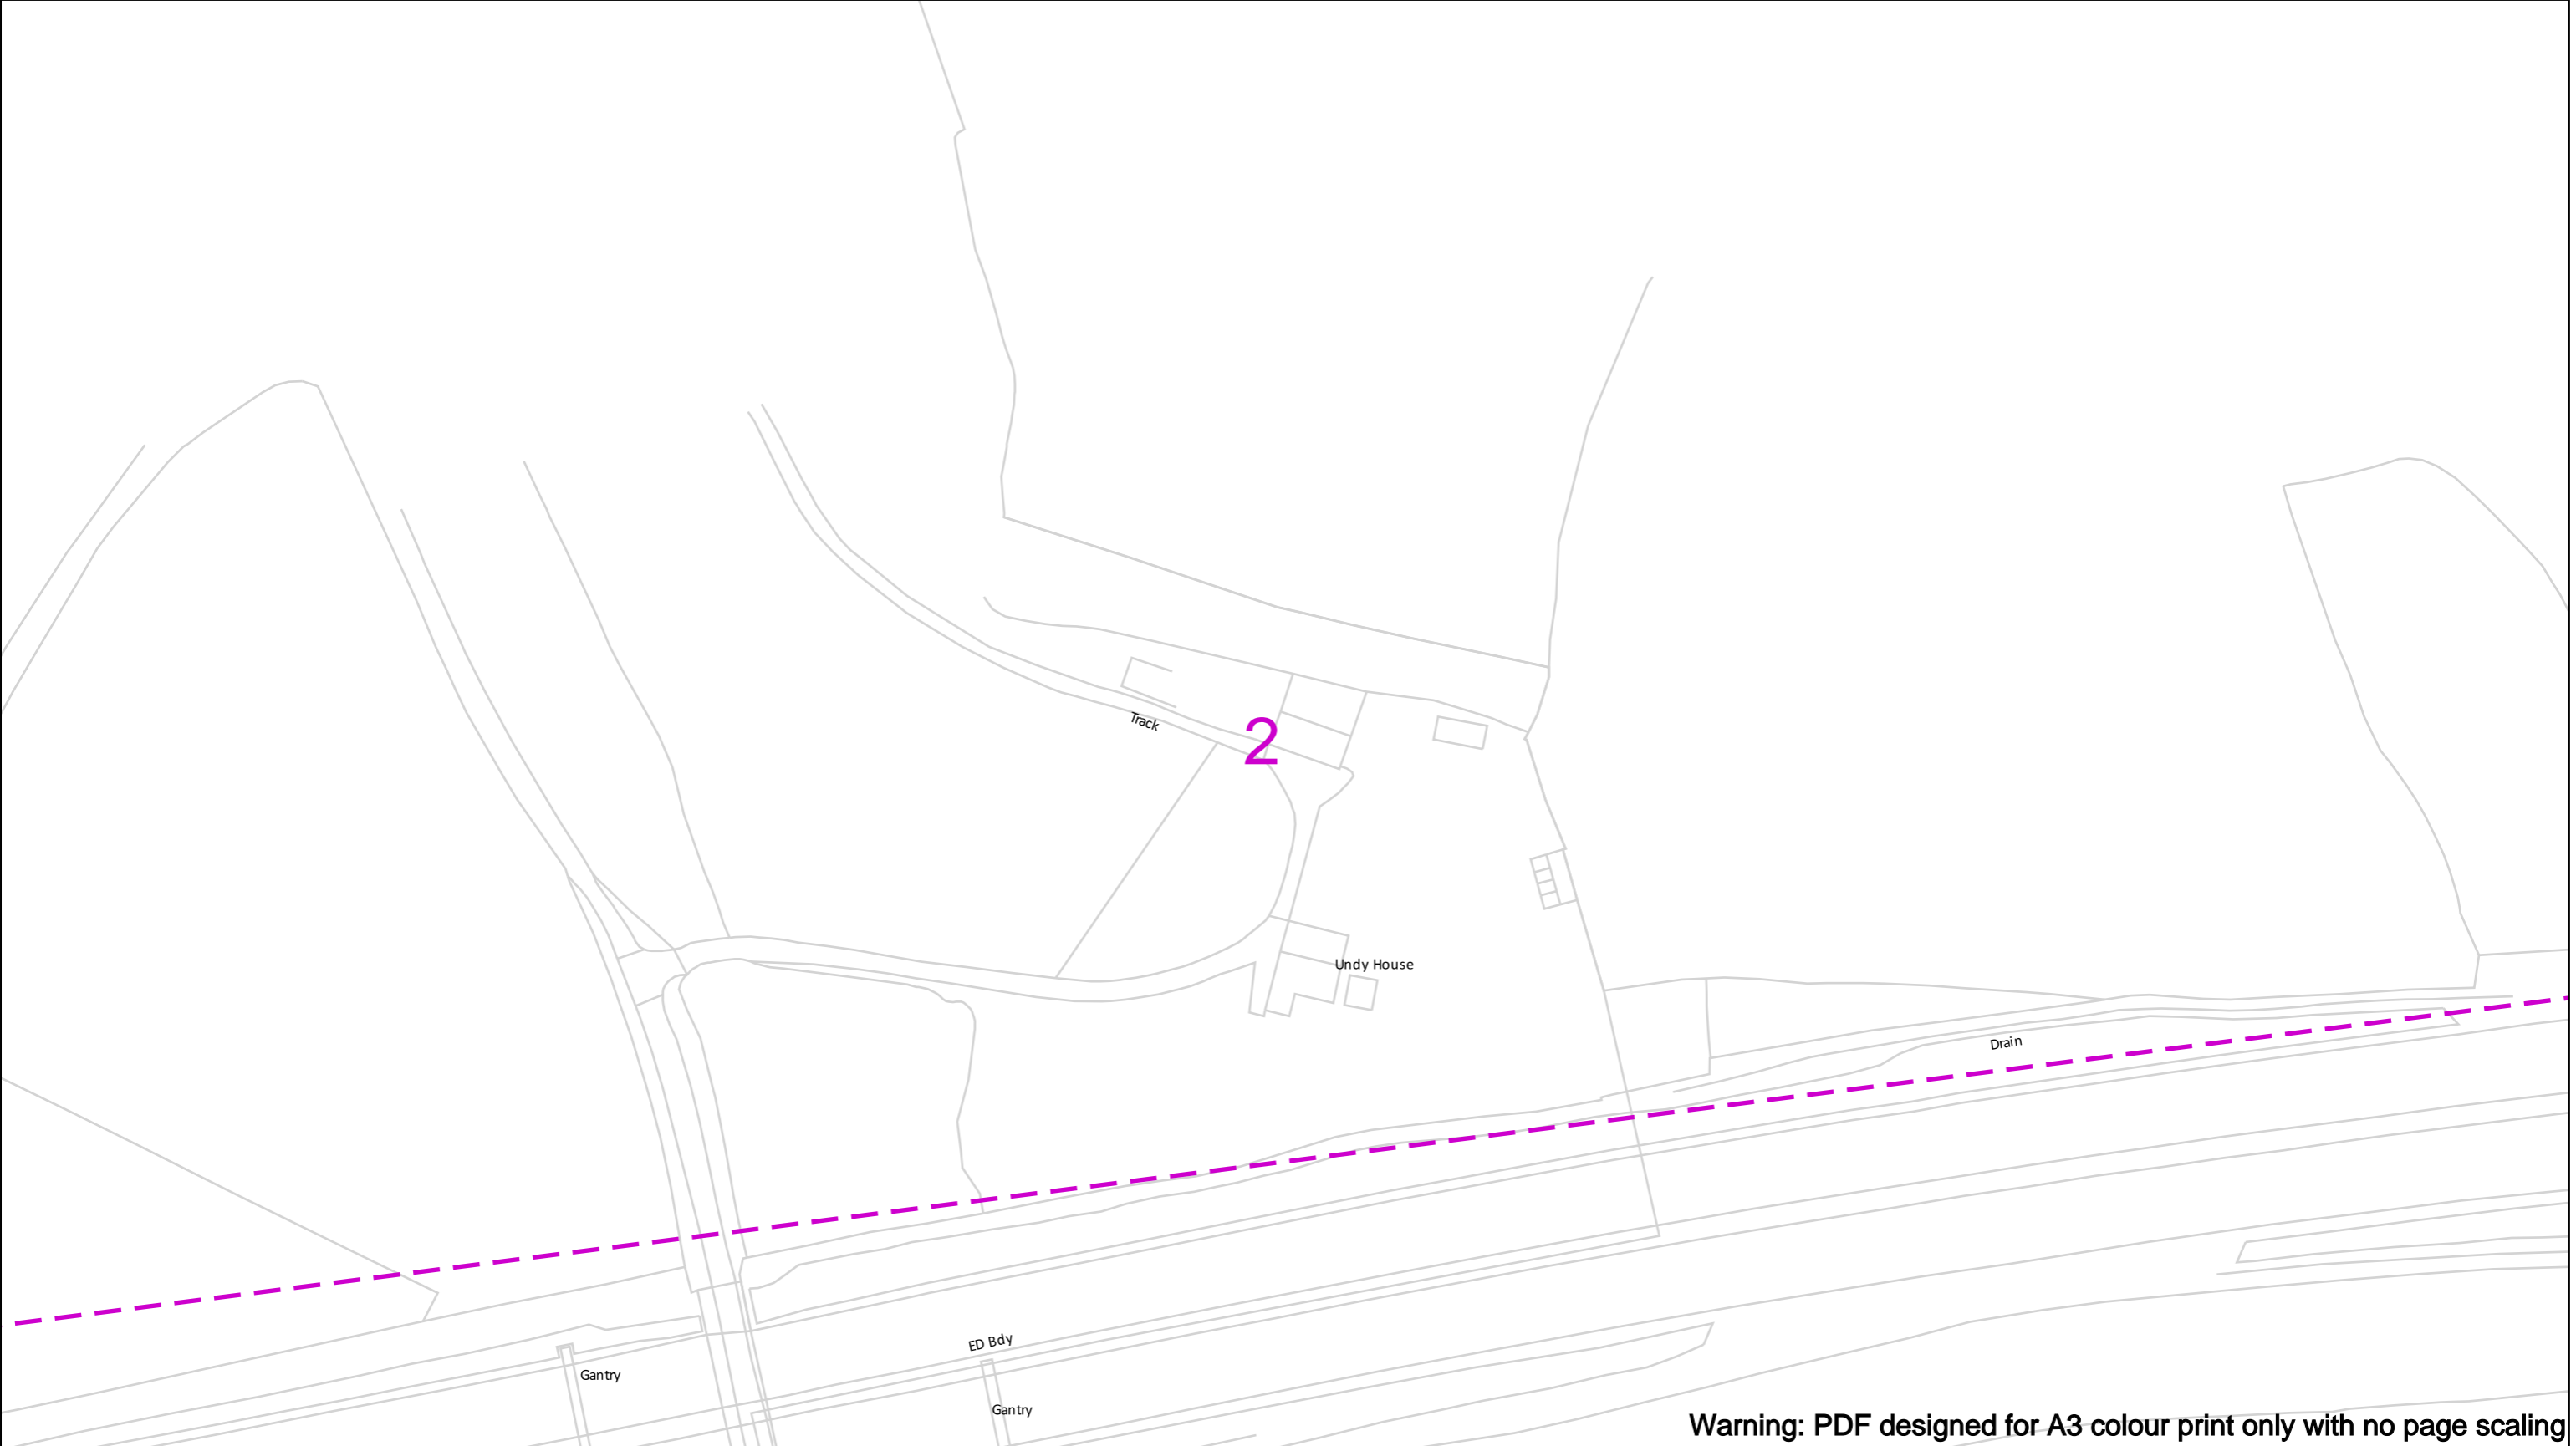

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629  
 Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

**In case of an emergency call 0800 111 999**



Dig Sites	Area: [Dashed Purple Line]	Line: [Dashed Purple Line]
[Red Solid Line]	Low Pressure (LP) 21mbar – 75mbar	
[Blue Dashed Line]	Medium Pressure (MP) 350mbar – 2bar	
[Green Dotted Line]	Intermediate Pressure (IP) 2bar – 7bar	
[Orange Dash-dot Line]	High Pressure (HP) >7bar	

[Valve Symbol]	Line/Fire Valve
[Governor Symbol]	Governor Station
[Change Symbol]	Change of Diameter
[End Cap Symbol]	End Cap
[Depth Symbol]	Depth of cover



**Dial before you dig**


We need 10 days' notice

Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.

Dial  
 Call 029 2027 8912 before you start work.

Investigate  
 Before you dig, make sure you know what's below.

Go ahead  
 Done your research? Now you can dig safely.

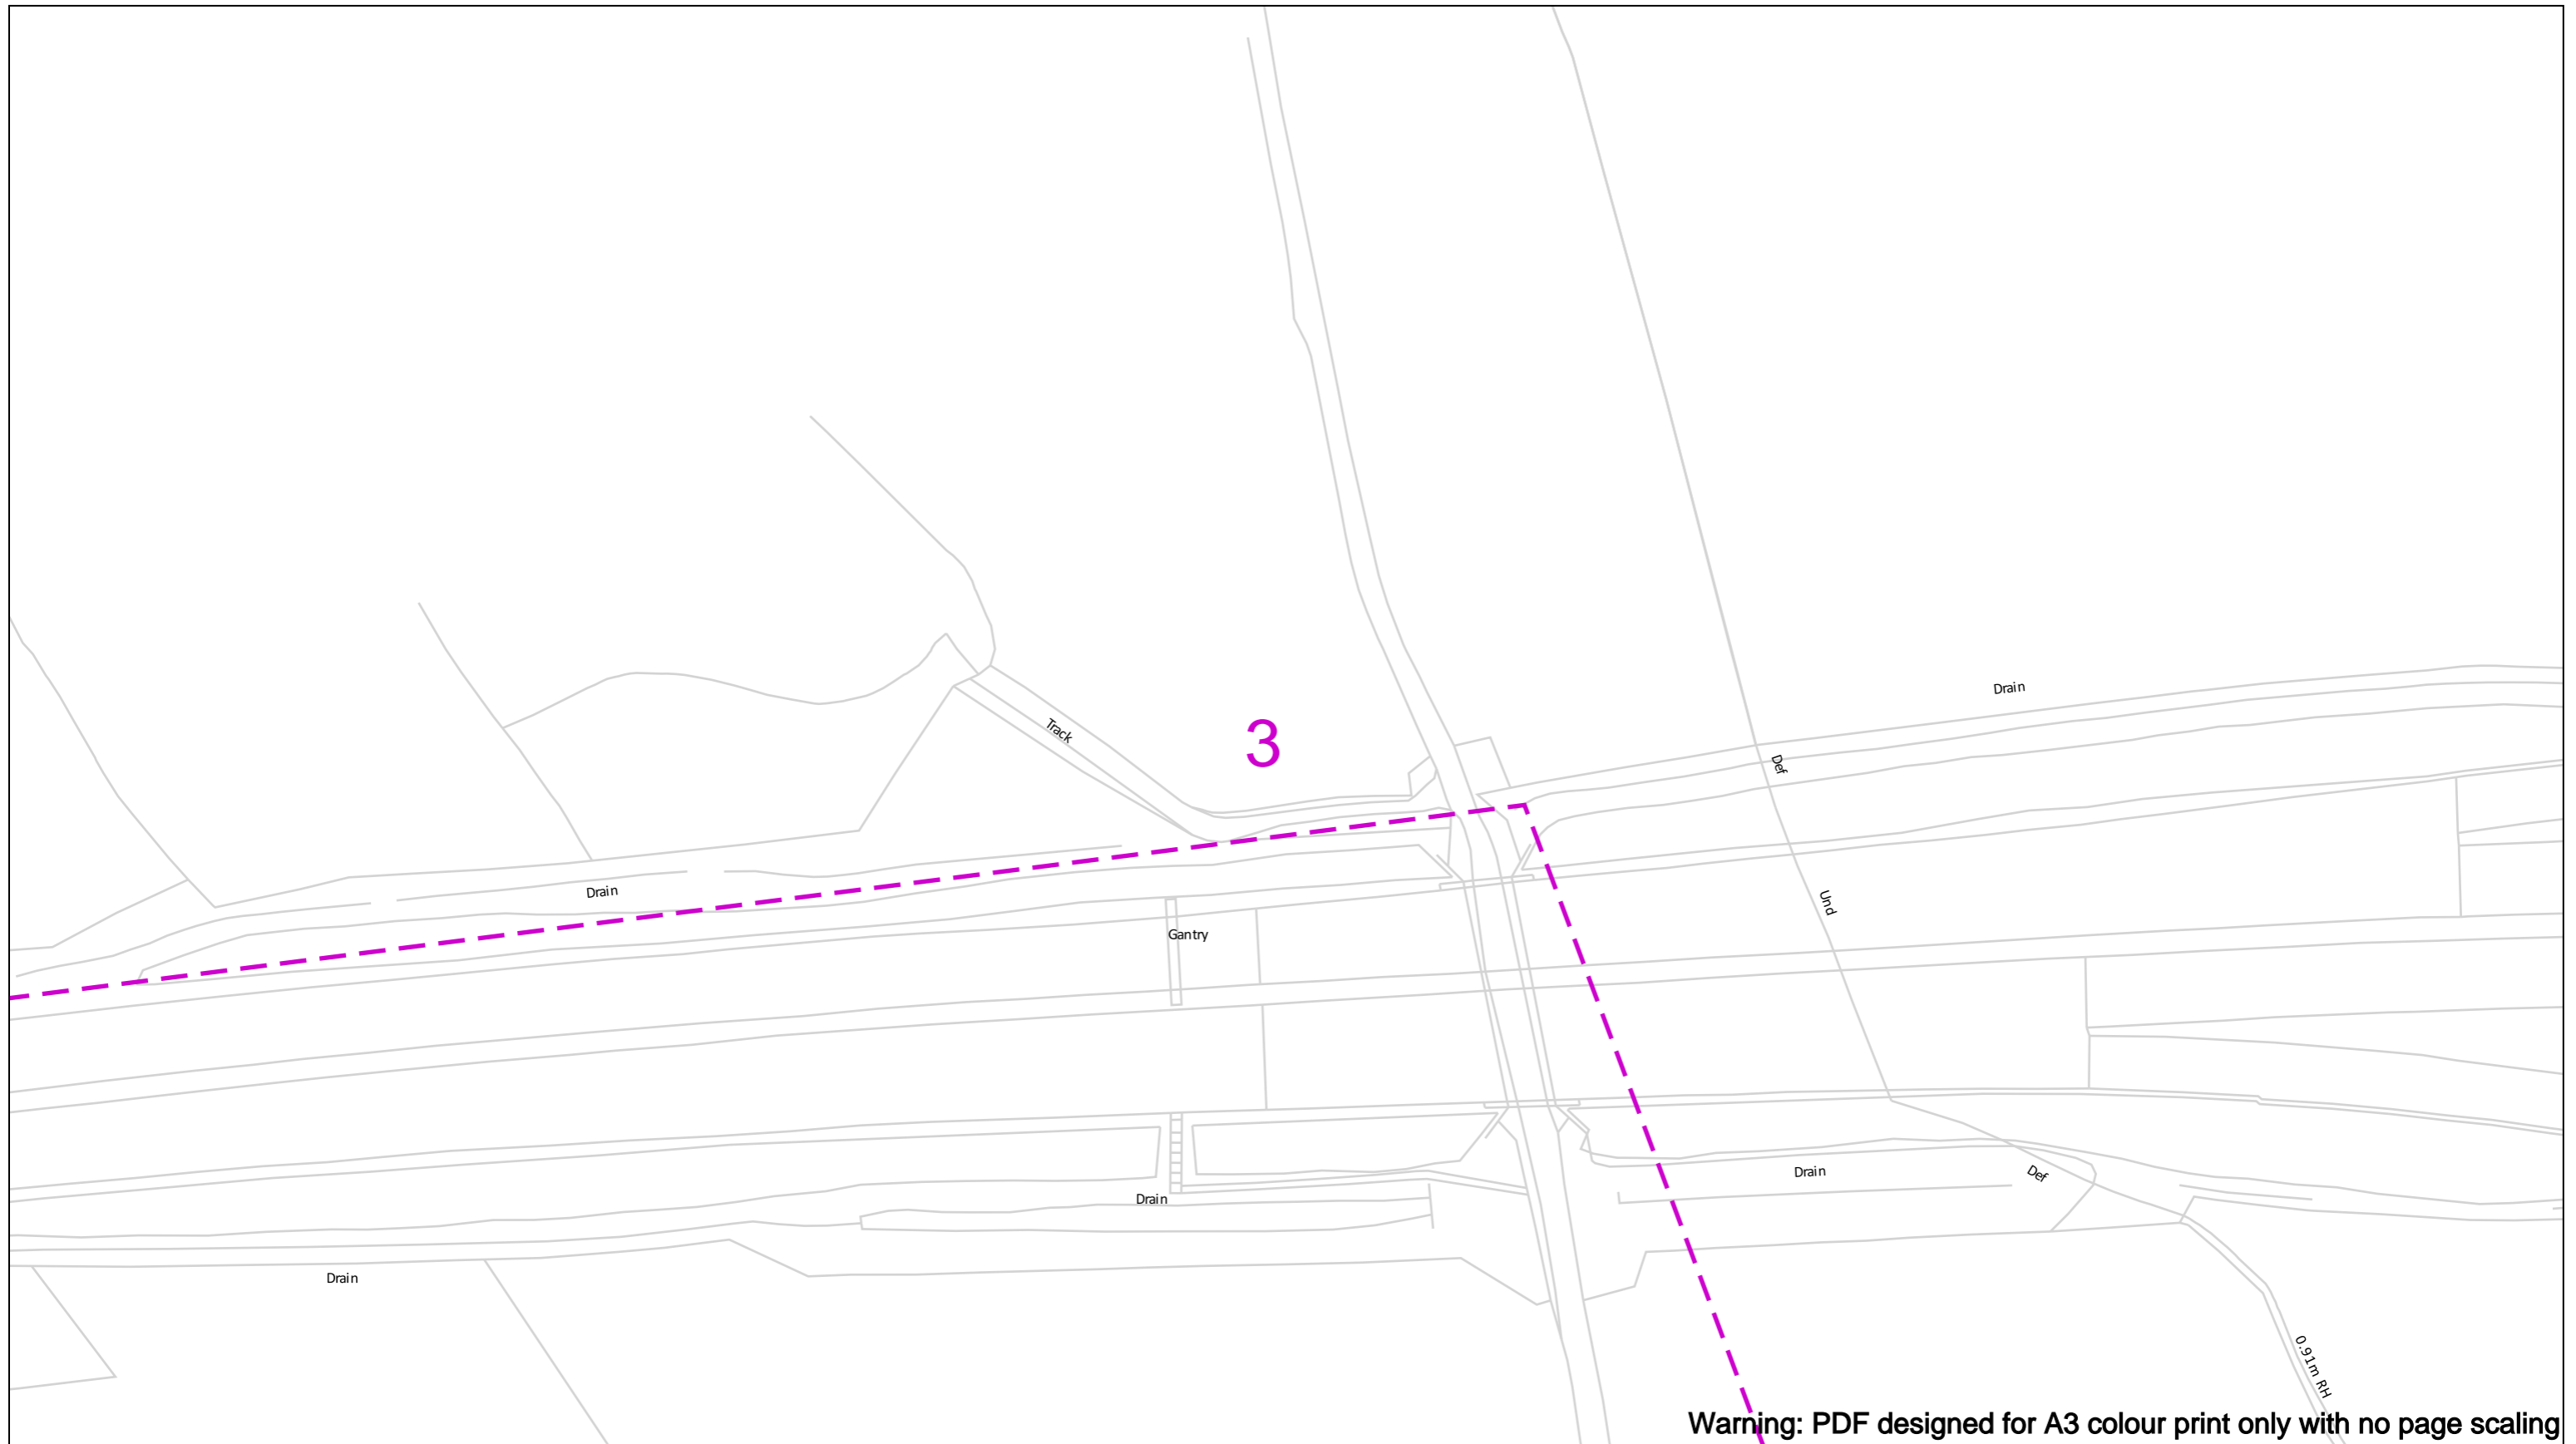

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629  
 Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

100m

<b>Dig Sites</b>	Area:	Line:
	Low Pressure (LP) 21mbar – 75mbar	
	Medium Pressure (MP) 350mbar – 2bar	
	Intermediate Pressure (IP) 2bar – 7bar	
	High Pressure (HP) >7bar	

	Line/Fire Valve
	Governor Station
	Change of Diameter
	End Cap
	Depth of cover

**WALES & WEST UTILITIES**

Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.


**Dial before you dig**

We need 10 days' notice

Dial  
 Call 029 2027 8912 before you start work.

Investigate  
 Before you dig, make sure you know what's below.

Go ahead  
 Done your research? Now you can dig safely.

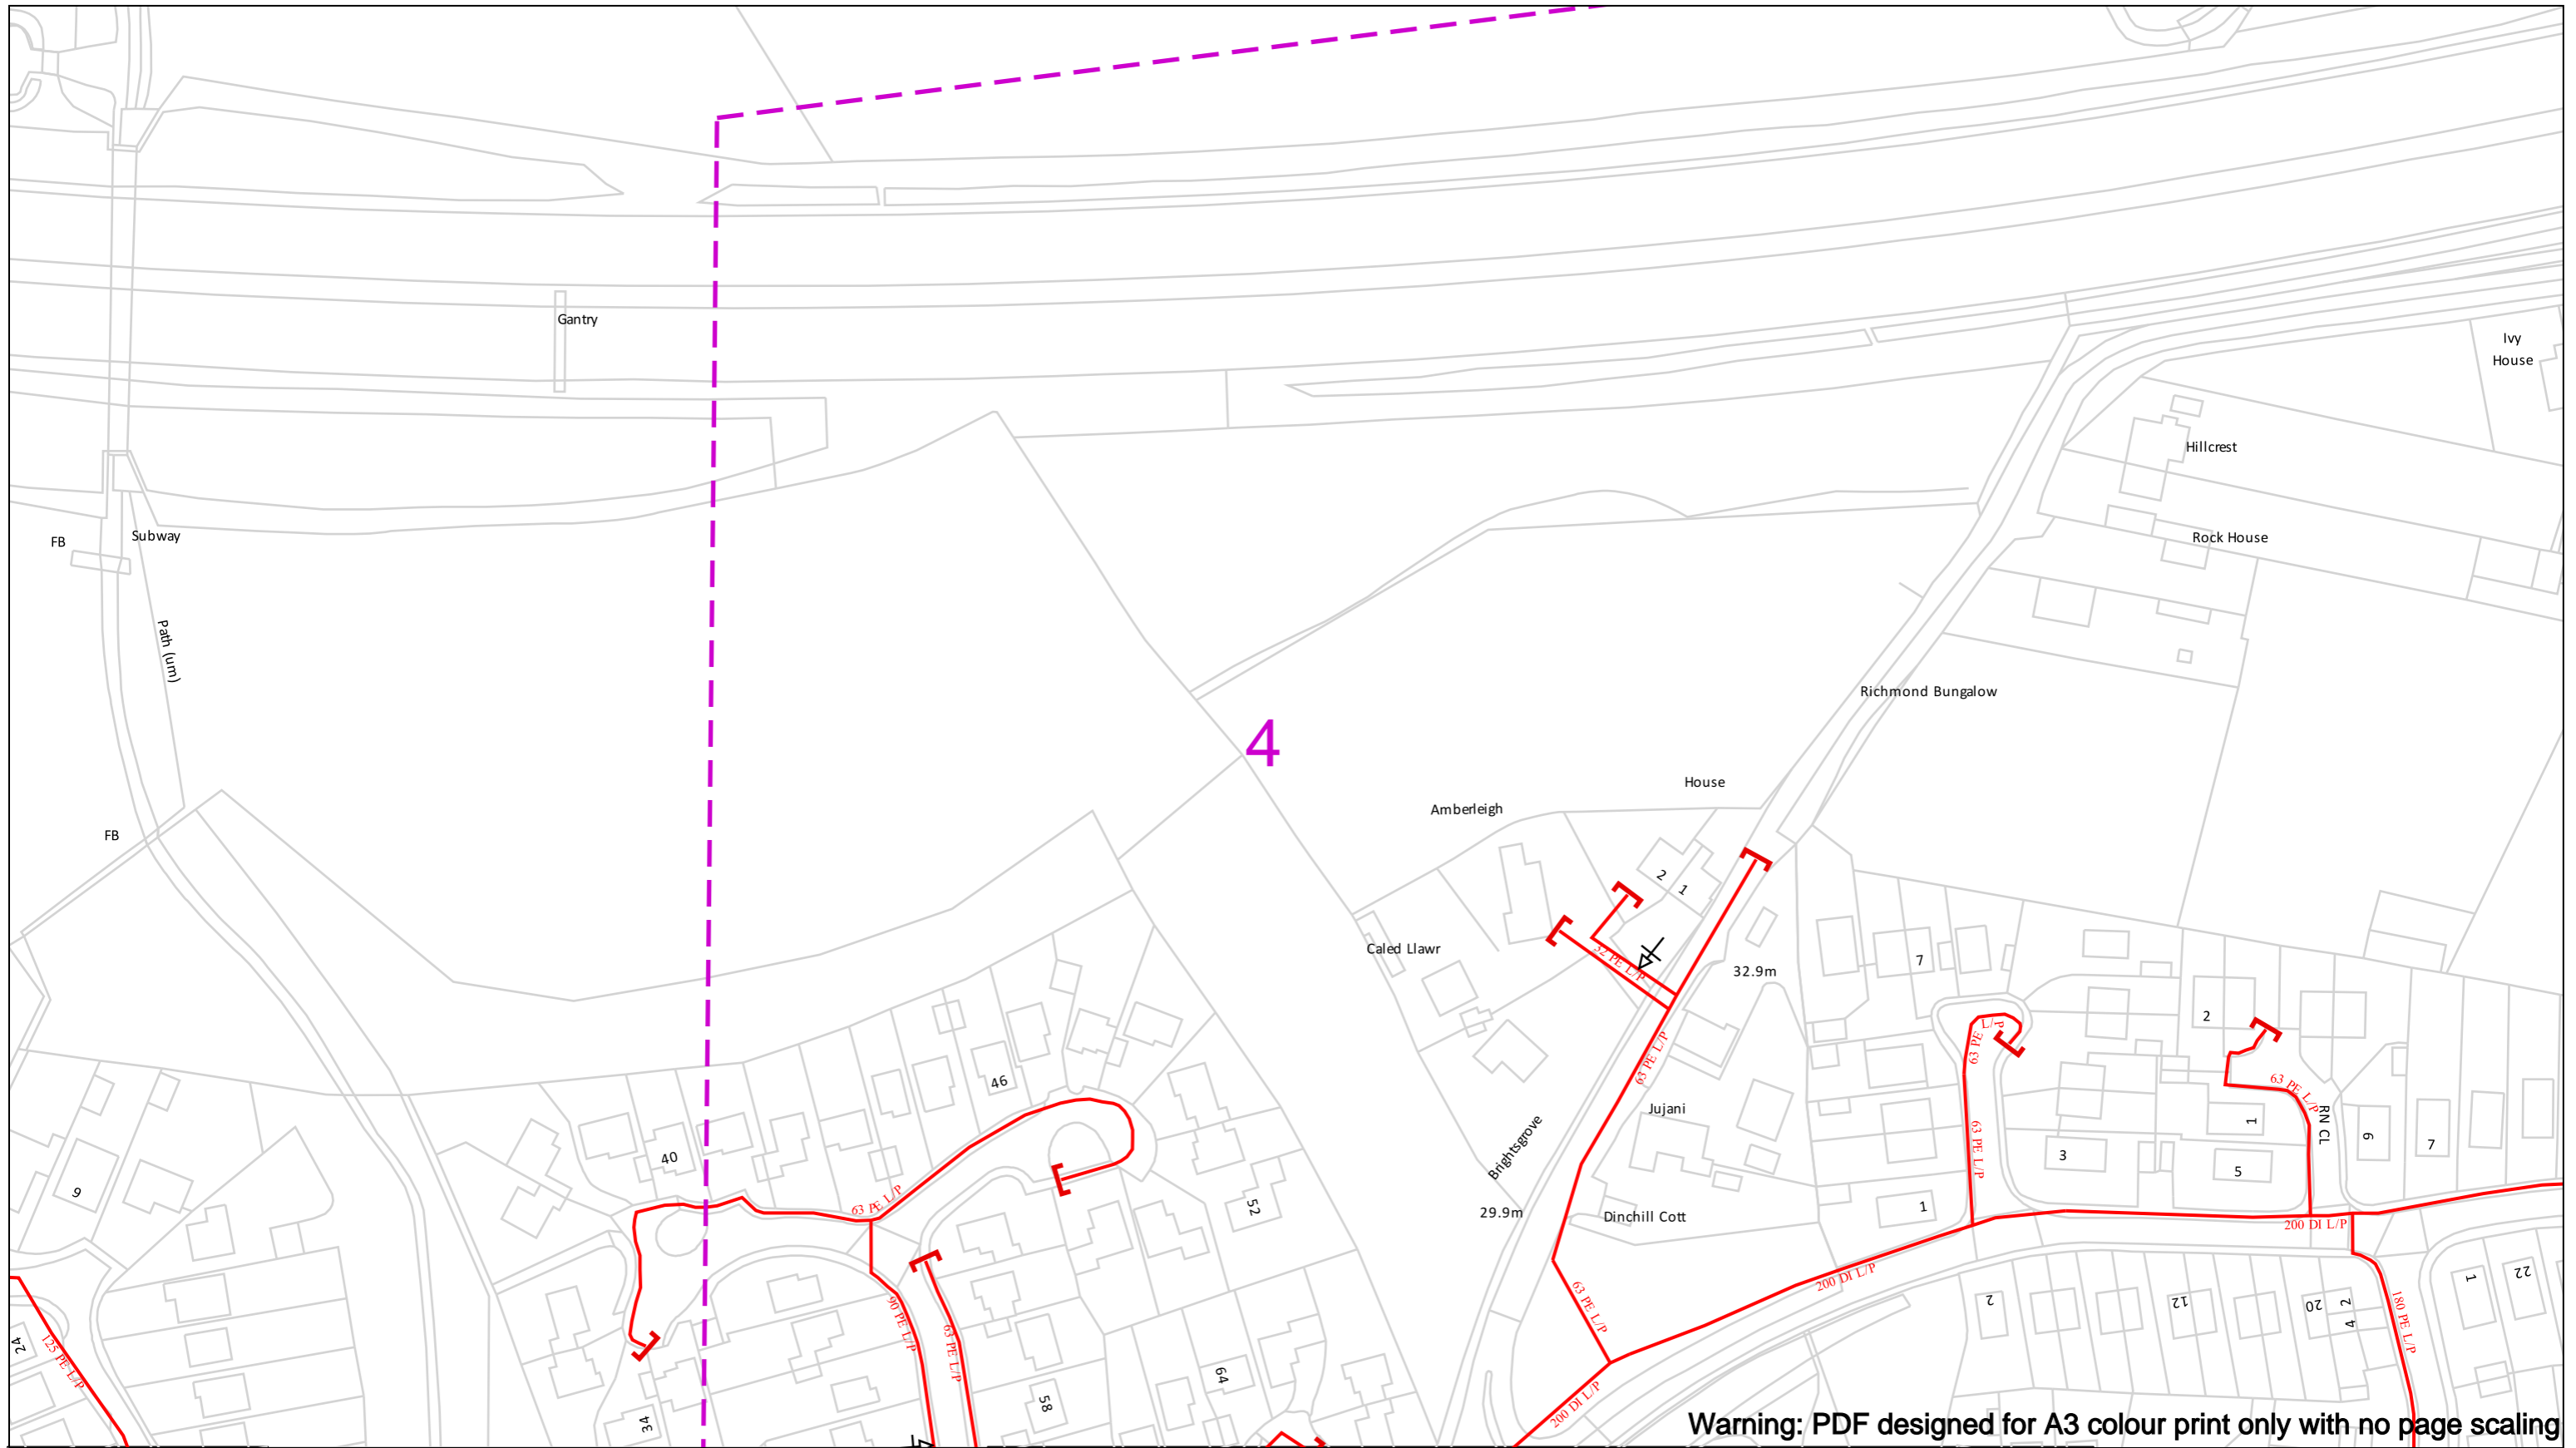

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629  
 Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WUU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WUU dig team on 02920 278912

**In case of an emergency call 0800 111 999**



Dig Sites	Area:	Line:
	Low Pressure (LP) 21mbar – 75mbar	
	Medium Pressure (MP) 350mbar – 2bar	
	Intermediate Pressure (IP) 2bar – 7bar	
	High Pressure (HP) >7bar	

	Line/Fire Valve
	Governor Station
	Change of Diameter
	End Cap
	Depth of cover



**Dial before you dig**

We need 10 days' notice


Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.

Dial 029 2027 8912 before you start work.

Investigate Before you dig, make sure you know what's below.

Go ahead Done your research? Now you can dig safely.



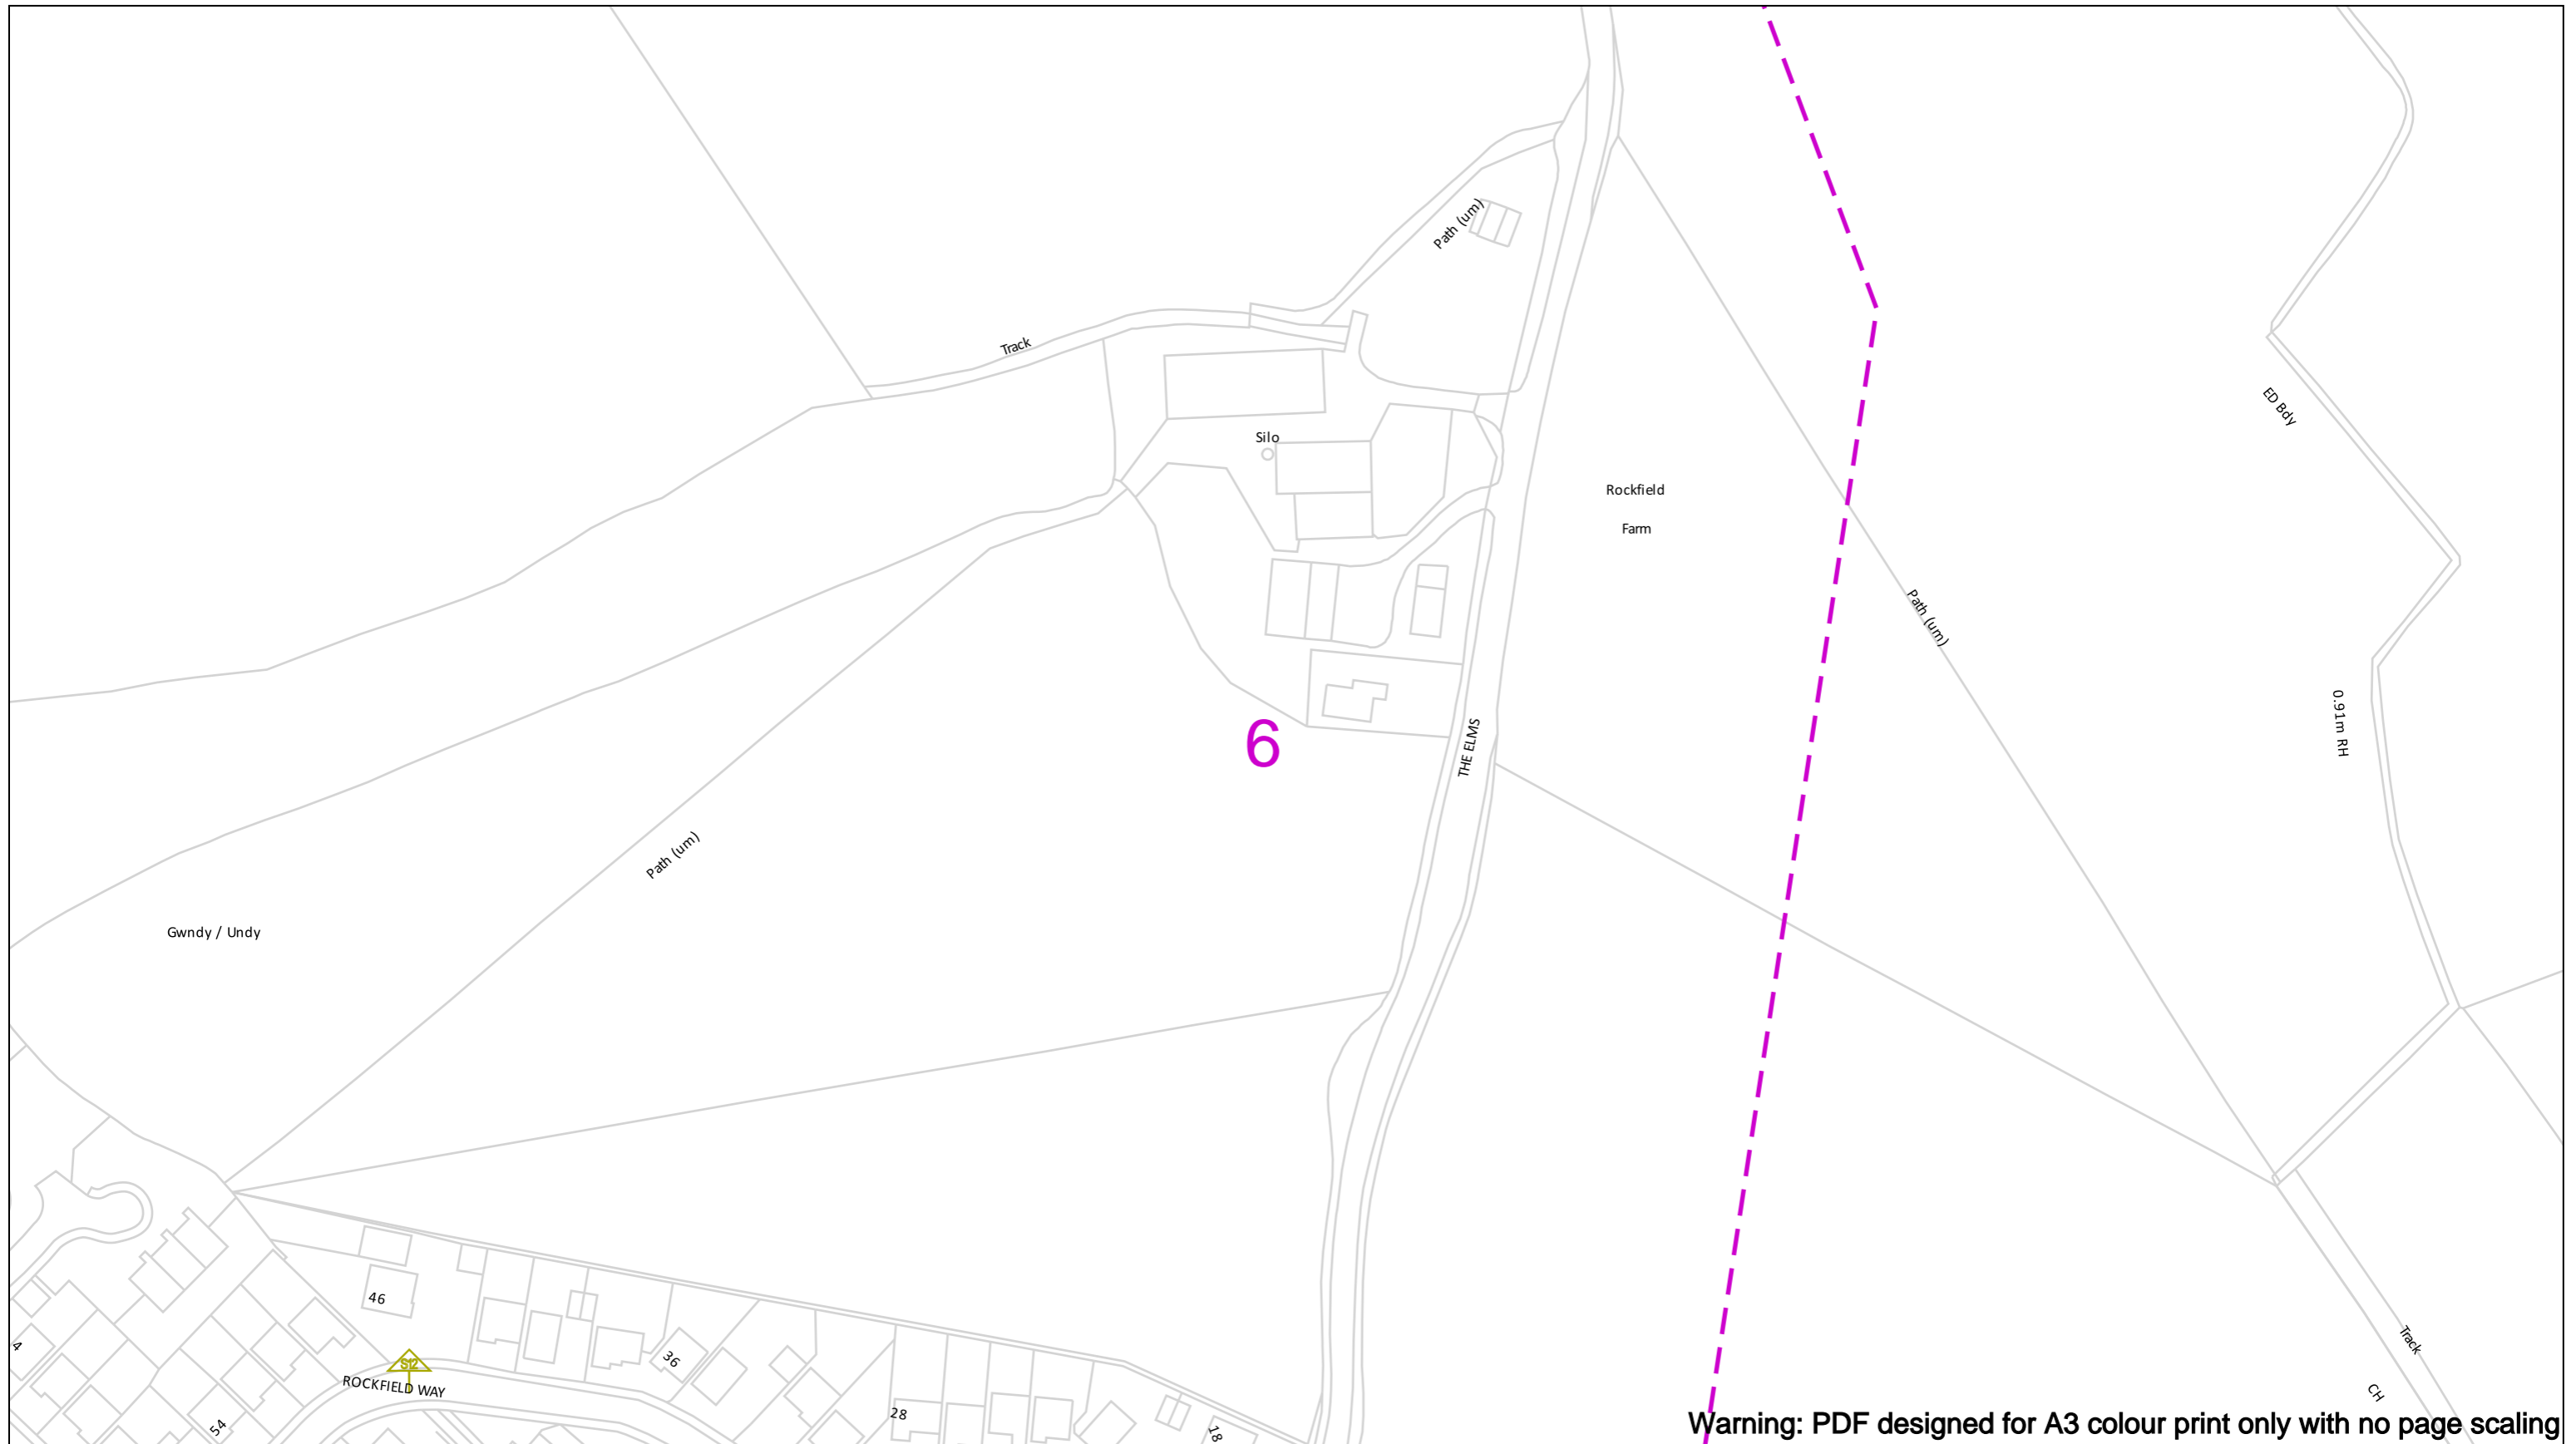

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629  
 Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WUU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WUU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

100m

<b>Dig Sites</b>	Area:	Line:
	Low Pressure (LP) 21mbar – 75mbar	
	Medium Pressure (MP) 350mbar – 2bar	
	Intermediate Pressure (IP) 2bar – 7bar	
	High Pressure (HP) >7bar	

	Line/Fire Valve
	Governor Station
	Change of Diameter
	End Cap
	Depth of cover

**WALES & WEST UTILITIES**

**Dial before you dig**


We need 10 days' notice

Smell gas? Call the Gas Emergency Service on 0800 111 999.

Dial Call 029 2027 8912 before you start work.

Investigate Before you dig, make sure you know what's below.

Go ahead Done your research? Now you can dig safely.

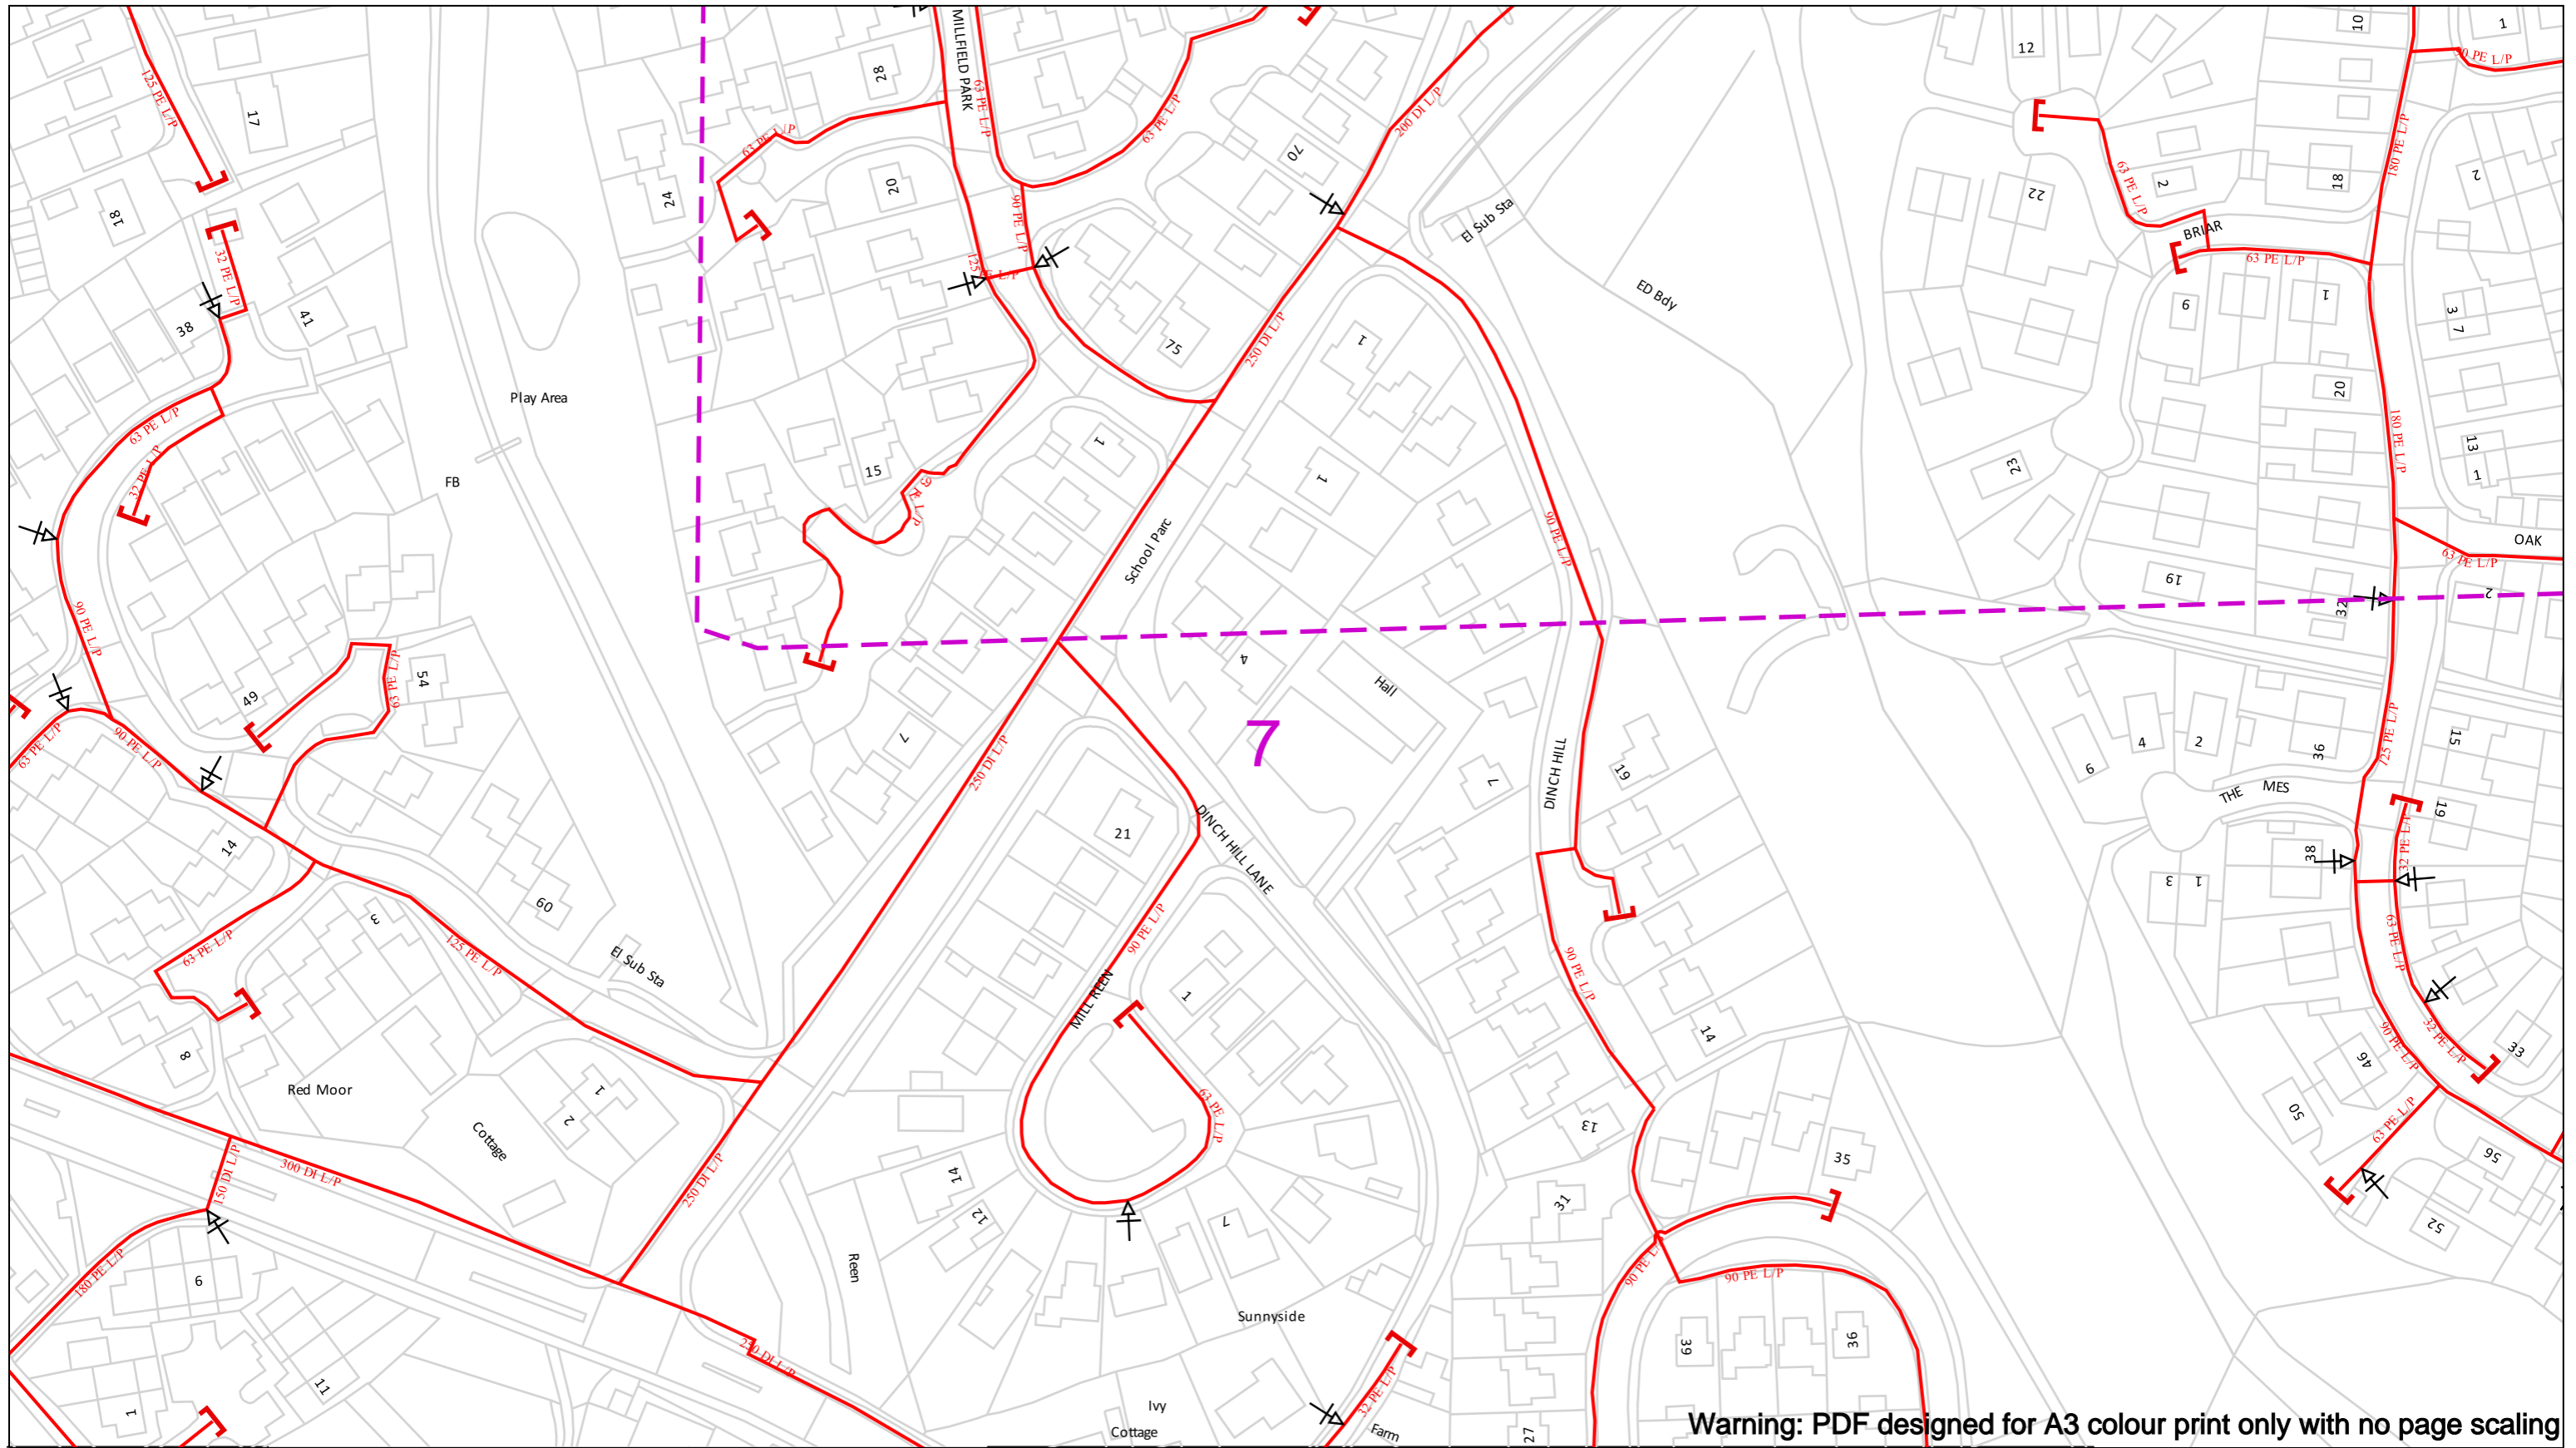

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629

Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WUU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WUU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

		Line/Fire Valve Governor Station Change of Diameter End Cap Depth of cover
<b>Dig Sites</b>	Area:  Line:	
	Low Pressure (LP) 21mbar – 75mbar	
	Medium Pressure (MP) 350mbar – 2bar	
	Intermediate Pressure (IP) 2bar – 7bar	
	High Pressure (HP) >7bar	

**Wales & West Utilities**

Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.

**Dial before you dig**


We need 10 days' notice

Dial 029 2027 8912 before you start work.

Investigate Before you dig, make sure you know what's below.

Go ahead Done your research? Now you can dig safely.



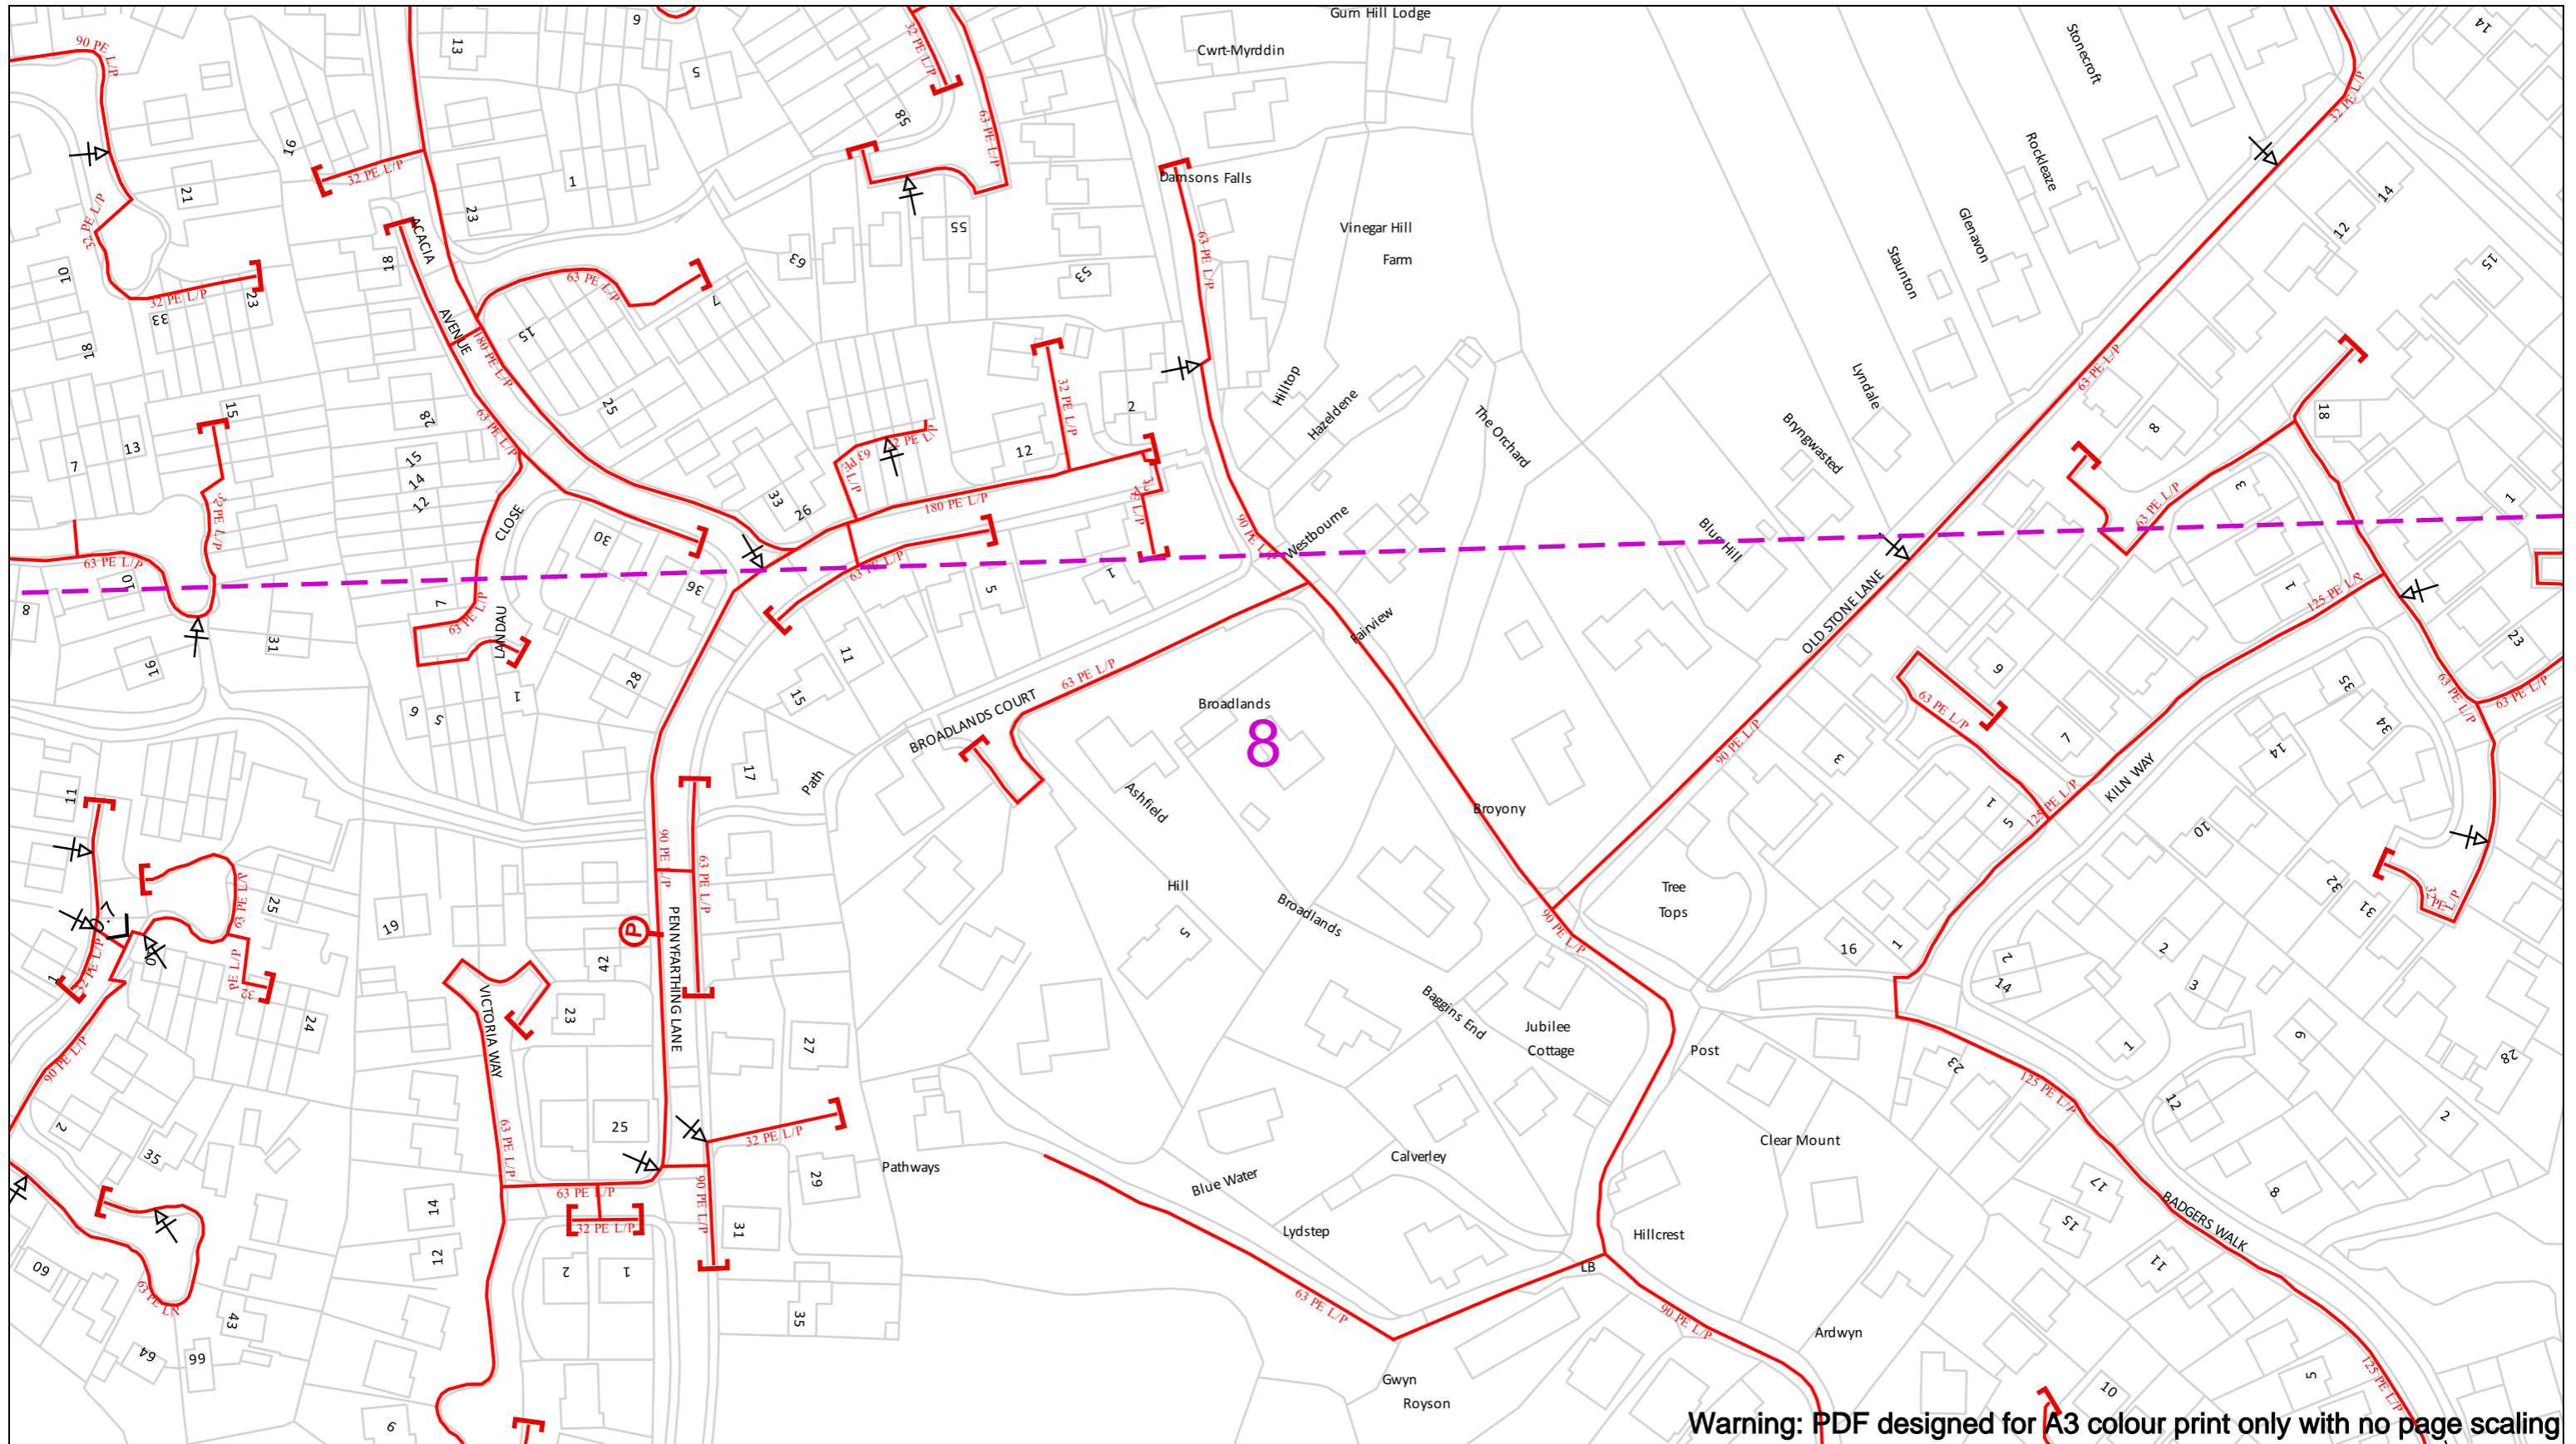

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629

Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WUU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WUU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

100m

	Dig Sites		Area:		Line:
					Low Pressure (LP) 21mbar – 75mbar
					Medium Pressure (MP) 350mbar – 2bar
					Intermediate Pressure (IP) 2bar – 7bar
					High Pressure (HP) >7bar

	Line/Fire Valve
	Governor Station
	Change of Diameter
	End Cap
	Depth of cover

**WALES & WEST UTILITIES**

Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.


**Dial before you dig**

We need 10 days' notice

**Go ahead**  
 Done your research? Now you can dig safely.

**Investigate**  
 Before you dig, make sure you know what's below.

**Dial**  
 Call 029 2027 8912 before you start work.

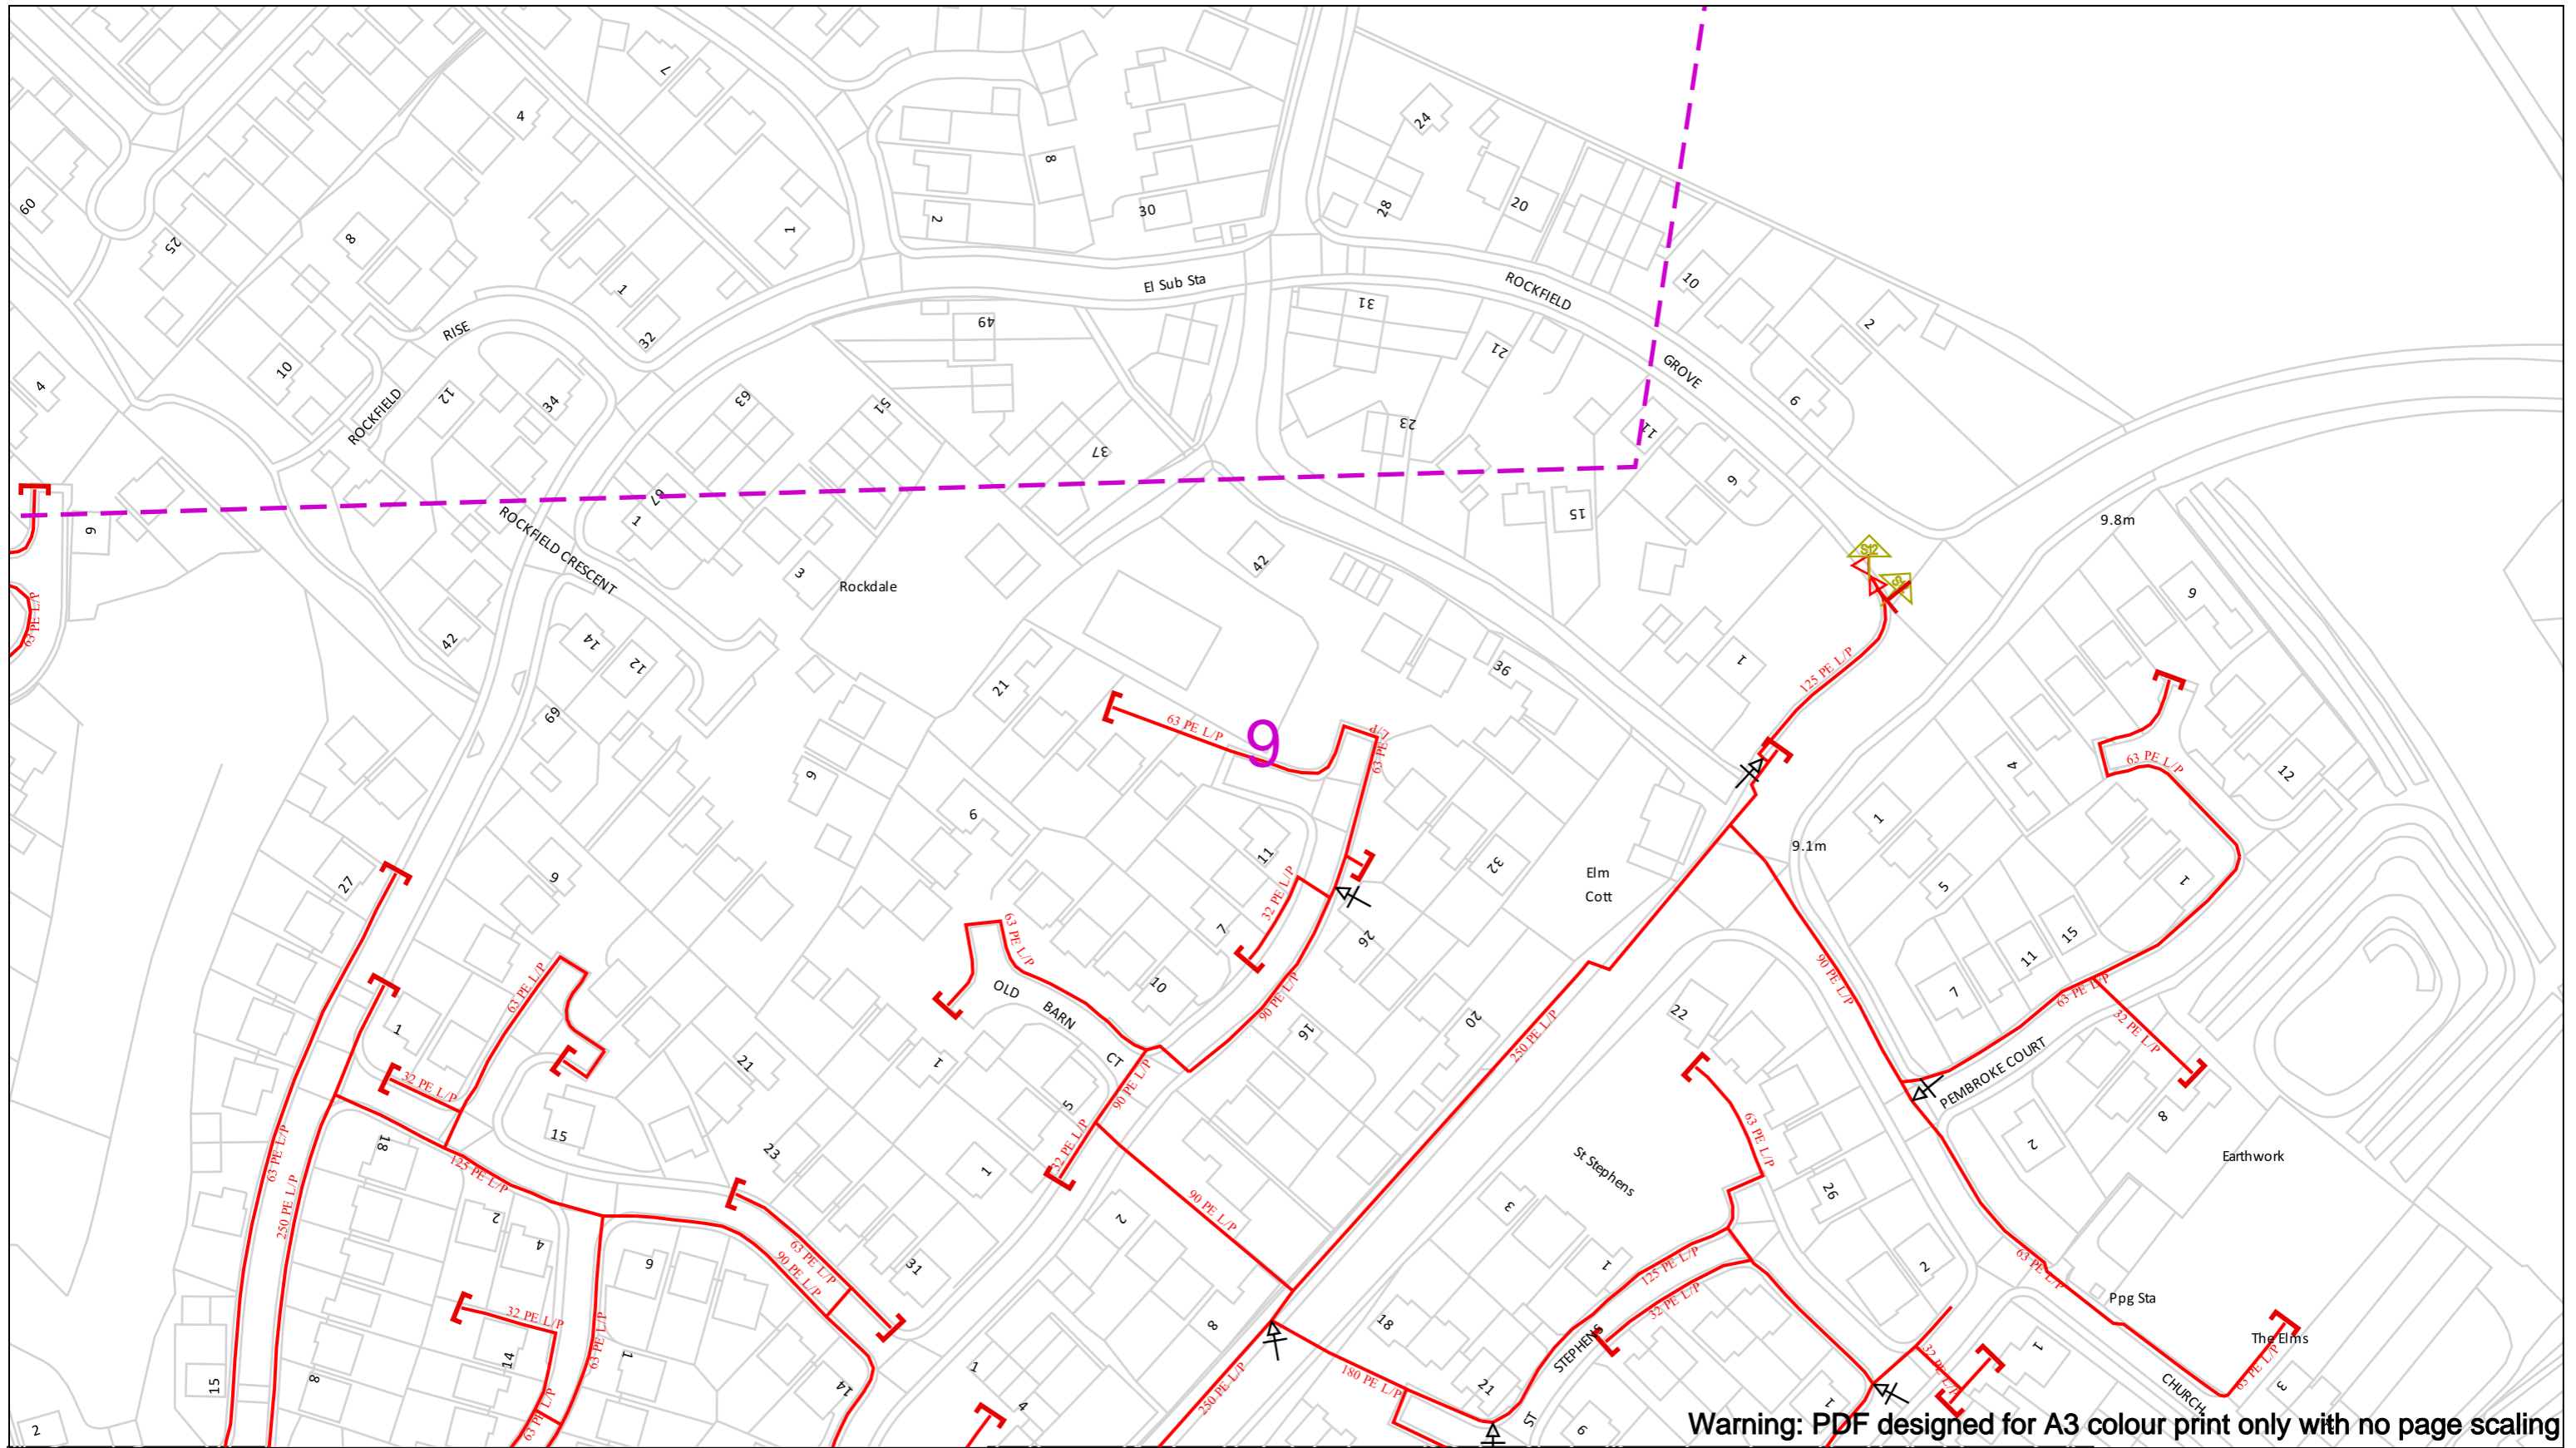

Contact Us  
 Mapping Enquiries: 02920 278 912  
 General Enquiries: 0800 912 2999

Date Requested: 04/08/2020  
 Job Reference: 19570550  
 Site Location: 343228 187629

Requested by:  
 Mrs Linda Lang  
 Your Scheme/Reference: Rockfield

Scale: 1:1250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WUU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with H5(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WUU dig team on 02920 278912

**In case of an emergency call 0800 111 999**

100m

<b>Dig Sites</b>	Area:	Line:
	Low Pressure (LP) 21mbar – 75mbar	
	Medium Pressure (MP) 350mbar – 2bar	
	Intermediate Pressure (IP) 2bar – 7bar	
	High Pressure (HP) >7bar	

	Line/Fire Valve
	Governor Station
	Change of Diameter
	End Cap
	Depth of cover

**WALES & WEST UTILITIES**

**Dial before you dig**

We need 10 days' notice

Smell gas?  
 Call the Gas Emergency Service on 0800 111 999.

Dial 029 2027 8912 before you start work.

Investigate Before you dig, make sure you know what's below.

Go ahead Done your research? Now you can dig safely.